

NOTE:

- WHERE DOUBLE WYE SERVICE ELEVATION IS LESS THAN 2'-7" BELOW PROPOSED BACK OFCURB, MIN. SLAB ELEV. MUST BE SET TO ALLOW SANITARY SEWER SERVICE.
- 2. MARK EACH SERVICE END WITH METAL "T" POST PAINTED GREEN.
- 3. ALL MATERIAL SHALL BE ASTM D3034 SDR26 W/ GASKETS.
- 4. ALL SERVICE CONNECTIONS & EXTENSIONS ARE TO BE INSTALLED WITH THE MAIN LINE CONSTRUCTION.
- 5. A CLEAN OUT IS REQUIRED AND WILL BE INSTALLED BY THE PLUMBER AT THE ROW FOR EACH LONG AND SHORT SIDE SERVICE.
- 6. LOT CORNERS SHALL BE MARKED WITH A LATH UNDER THE SUPERVISION OF A RPLS UPON COMPLETION OF CONSTRUCTION.
- 7. WHEN SERVICE CONNECTION IS DEEP, CONTRACTOR MUST PLACE A VERTICAL STACK THAT SHALL BE BROUGHT WITHIN 3-1/2 FEET BELOW NATURAL GROUND.





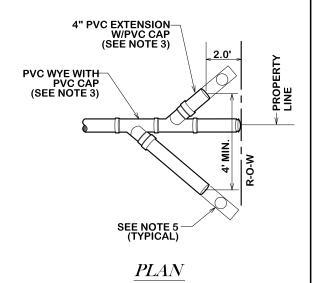

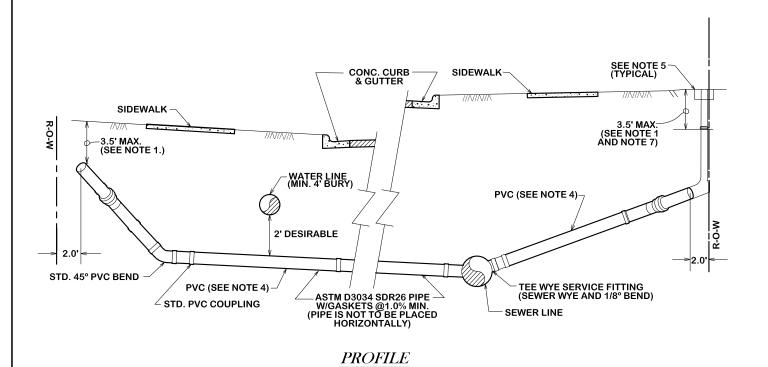

CITY OF COLLEGE STATION SEWER SERVICE LINE CROSSING

DATE

DECEMBER 2020

B/CS UNIFIED STANDARD DETAIL

DETAIL NO.

S7-00

